


GENERAL NOTES (APPLY TO 1/M100)

- EXPOSED DUCTWORK SHALL BE ROUND DOUBLE WALL INSULATED SPIRAL SHEET METAL CONSTRUCTION.

KEY NOTES (APPLY TO 1/M100)

- REMOTE TEMPERATURE SENSOR.
- REFER TO 2/M100 FOR CONTINUATION.
- 12" DEEP PLENUM. FULL SIZE OF LOUVER.
- 12" DEEP PLENUM. FULL SIZE OF EXISTING LOUVER.
- ROUTE 1" CONDENSATE DOWN IN THE WALL TO HUB DRAIN LOCATED IN MECHANICAL CLOSET. REFER TO PLUMBING DRAWINGS.

1 MECHANICAL - LEVEL 2 FLOOR PLAN
Scale: 1/8" = 1'-0"

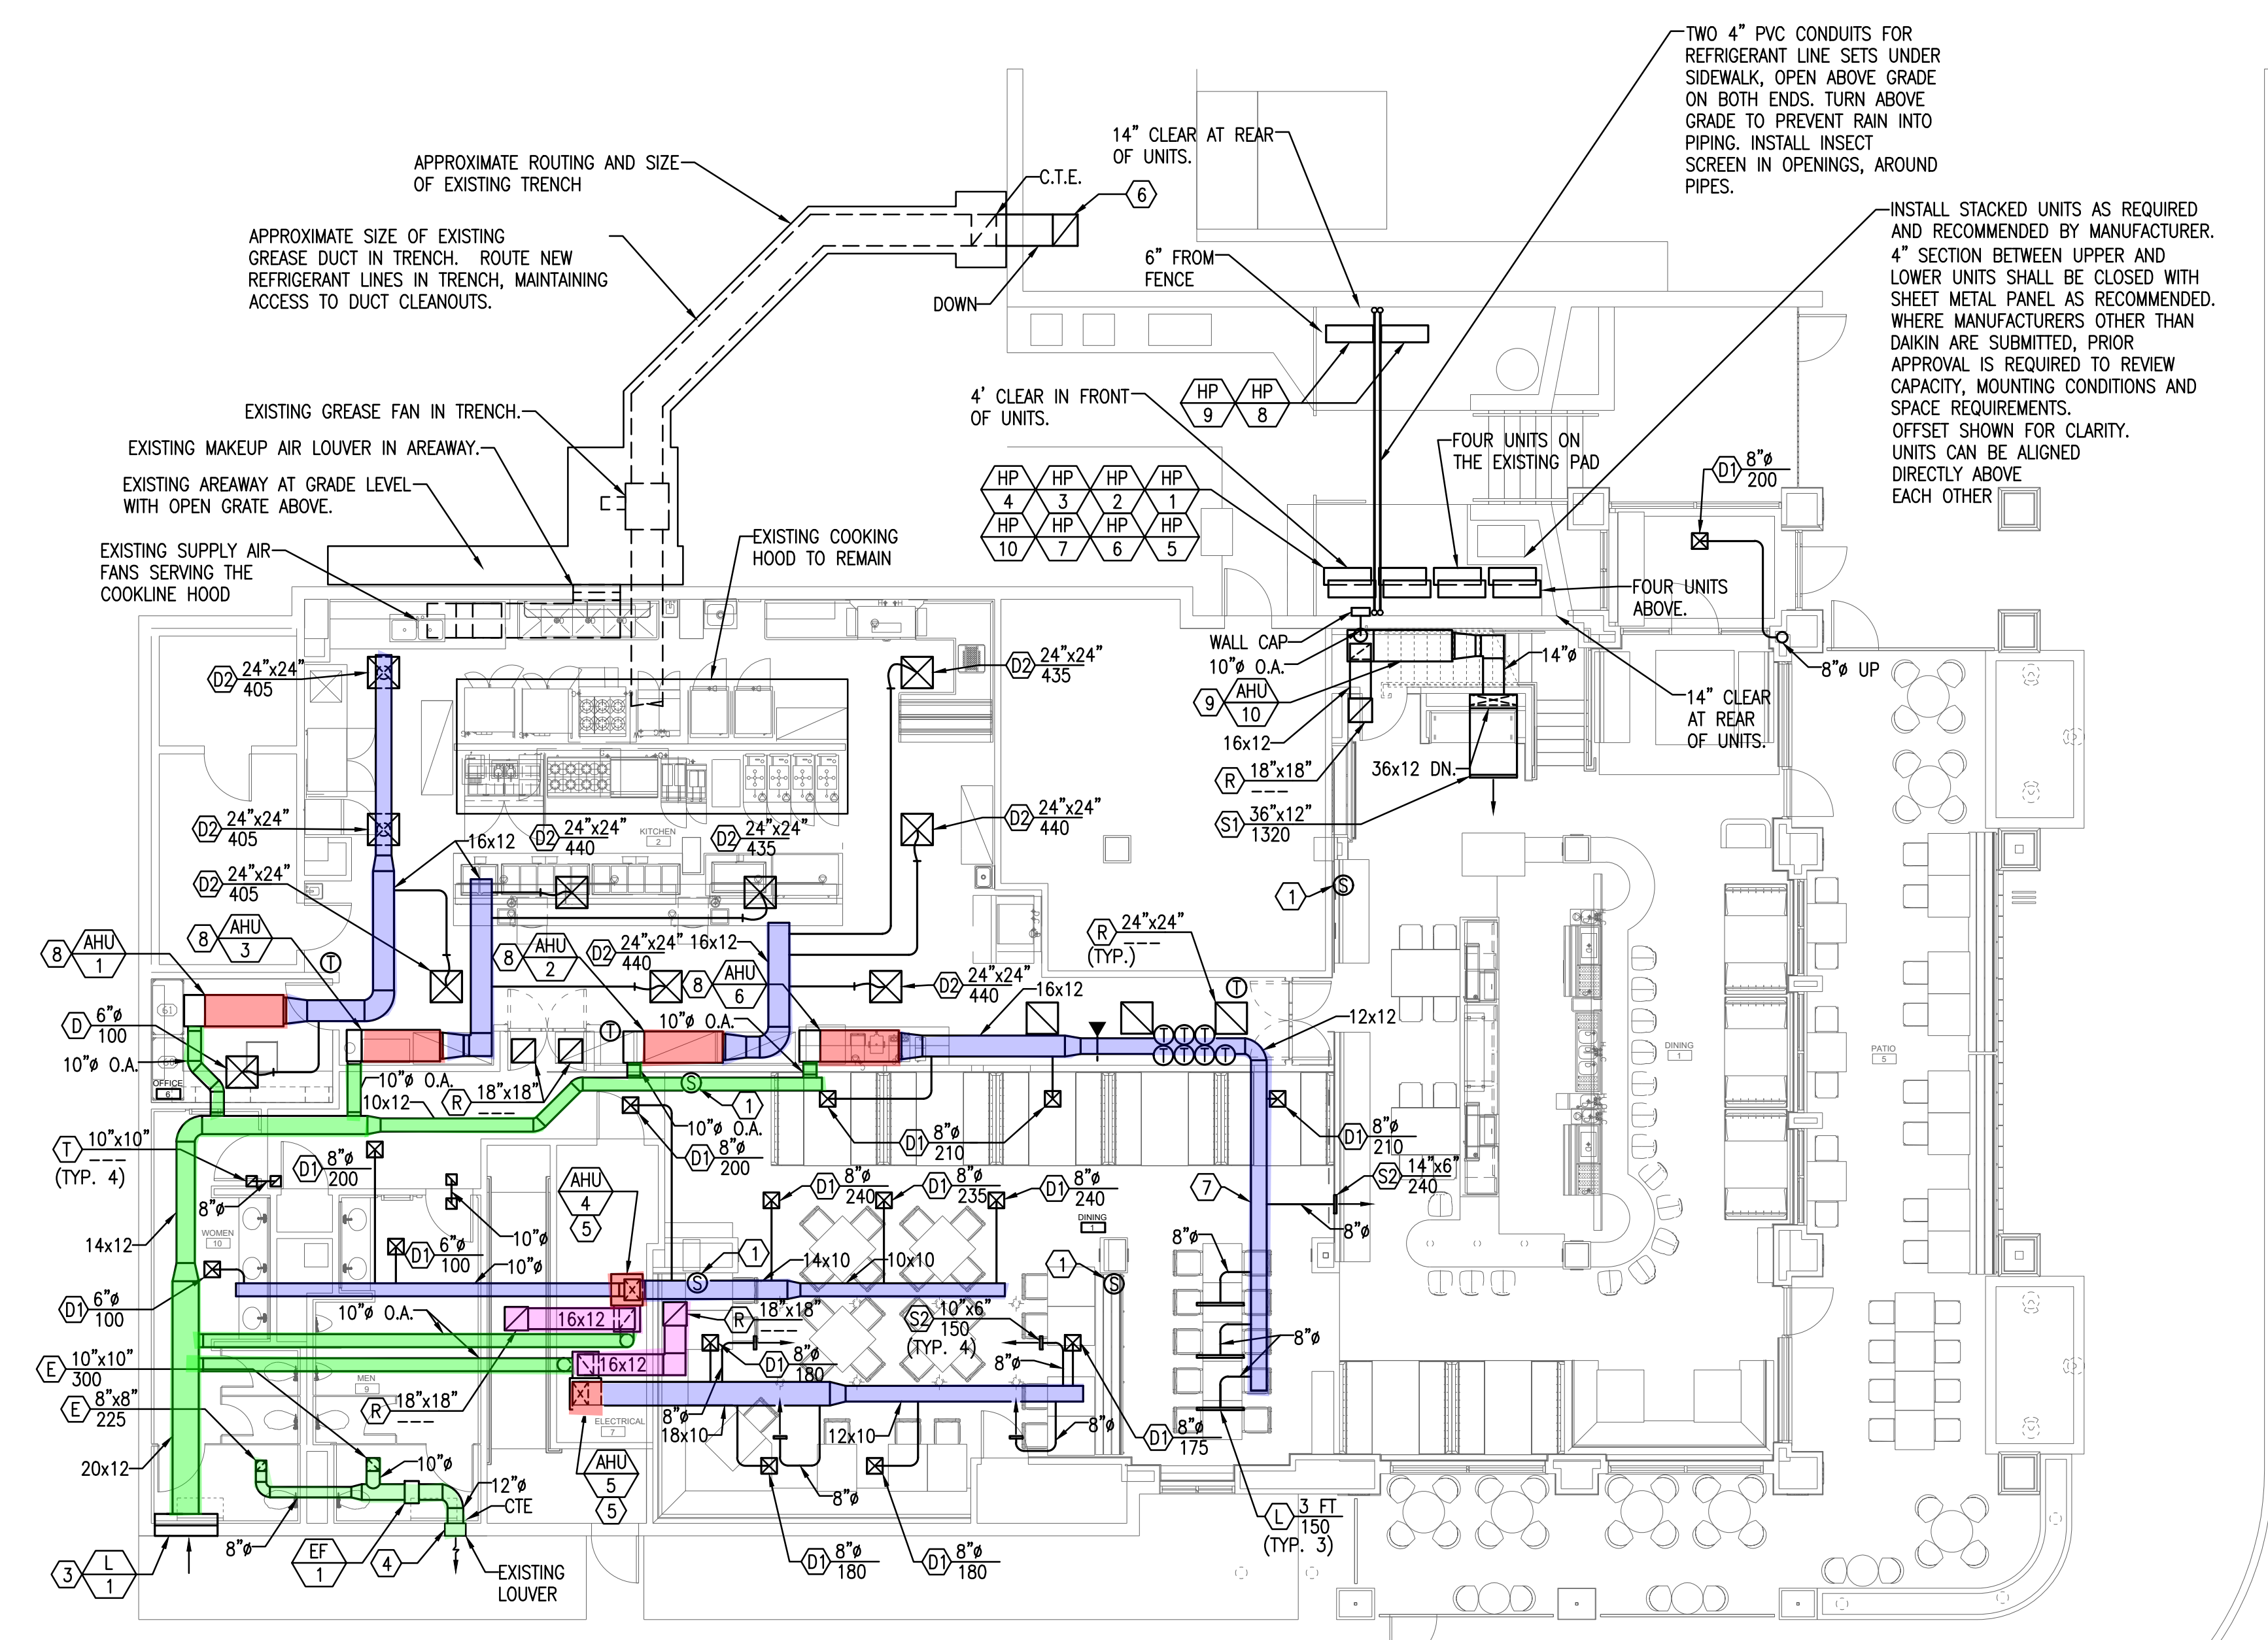

KEY NOTES (APPLY TO 2/M100)

- REMOTE TEMPERATURE SENSOR.
- 14" DEEP PLENUM. FULL SIZE OF RETURN GRILLE.
- 18" DEEP PLENUM. FULL SIZE OF LOUVER.
- 12" DEEP PLENUM. FULL SIZE OF EXISTING LOUVER.
- ROUTE 1" CONDENSATE TO FLOOR DRAIN LOCATED IN "ELECTRICAL 7". REFER TO PLUMBING DRAWINGS.
- NEW GREASE DUCT. MATCH EXISTING GREASE DUCT SIZE AND MATERIAL.
- CONCEAL DUCTWORK ABOVE CEILING.
- ROUTE 1" CONDENSATE TO HUB DRAIN LOCATED IN "KITCHEN 2". REFER TO PLUMBING DRAWINGS.
- ROUTE 1" CONDENSATE TO HUB DRAIN LOCATED IN MECHANICAL CLOSET. REFER TO PLUMBING DRAWINGS.

HOOD BALANCING NOTES:

- CONTRACTOR SHALL HAVE TEST AND BALANCE COMPANY TEST AIRFLOW OF HOOD SUPPLY FANS AND EXHAUST FAN PRIOR TO START OF WORK.
- FANS SHALL BE PLACED IN OPERATION PRIOR TO AIRFLOW TESTING.
- AIRFLOW REQUIREMENTS OF EXISTING HOOD ARE TO BE MAINTAINED. PROVIDE EXISTING AIRFLOW RATES TO ARCHITECT/ENGINEER FOR VERIFICATION AND COORDINATION WITH FINAL AIR BALANCE CONDITIONS.

2 MECHANICAL - LEVEL 1 FLOOR PLAN
Scale: 1/8" = 1'-0"

BUSY BEE CAFE
ATLANTA, GA 30303

Project Data

Submission	Date
RELEASED FOR CONSTRUCTION	07/30/2018

TITLE
MECHANICAL - LEVEL 1 & 2 FLOOR PLAN

a3 Project Number: 2018.03
Drawing Date: 07/30/18
Scale: As Noted

Drawing Number
M100